

BATTERY TEST REPORT

IEC60896-21:2004/TCVN11850-21:2017

IEC60896-22:2004/TCVN11850-22:2017

Report Reference No : TQ2504016

Tester (printed name and signature) : *Nguyen*

Check by (printed name and signature) : *[Signature]*

Approved by (printed name and signature) : *[Signature]*

Date of issue (DD/MM/YYYY) : 19/04/2025

Testing laboratory : Laboratory Le Long Viet Nam Limited Company

Address / Địa chỉ : Duc My industrial clusters, Duc Hoa Dong commune, Duc Hoa district, Long An province, Viet Nam

Tell : +84-72-3779666

Applicants Name : LELONG VIETNAM LIMITED COMPANY

Address : 40 Ba Chanh Thau Street, quarter 2, Ben Luc town, Ben Luc district, Long An province, Viet Nam

Tell : 84-272-387 2213

Test Specification

Standard / tiêu chuẩn : IEC60896-21:2004/TCVN11850-21:2017 ; IEC60896-22:2004/TCVN11850-22:2017

Non-standard test method : N/A

Test Report Form No : IEC60896-21:2004/TCVN11850-21:2017 ; IEC60896-22:2004/TCVN11850-22:2017

Test item description : Valve Regulated Lead-Acid Battery

Trade Mark : **LONG**

Model/Type reference : WPL200-12N

Series model : N/A

Rating(s) : 12V 200Ah

Battery dimension : 522mm x 238mm x 224mm (LxWxH)

Possible Test Case Verdicts:

Test case does not apply to the test object : N/A


Test object does meet the requirement : P(Pass)

Test object does not meet the requirement : F(Fail)

1. Test results are valid for the namely submitted sample(s) only
2. This test report shall not be reproduced, except in full, without the written approval of LELONG VIETNAM
3. Laboratory has been certificated by the Vietnamese (BoA) Quality Notarization Office in accordance with ISO/IEC 17025:2017 (VILAS 1048) , (*) will indicate a non-certified items.
4. (**) According to laboratory decision-making rules



Trade Mark And Dimension:

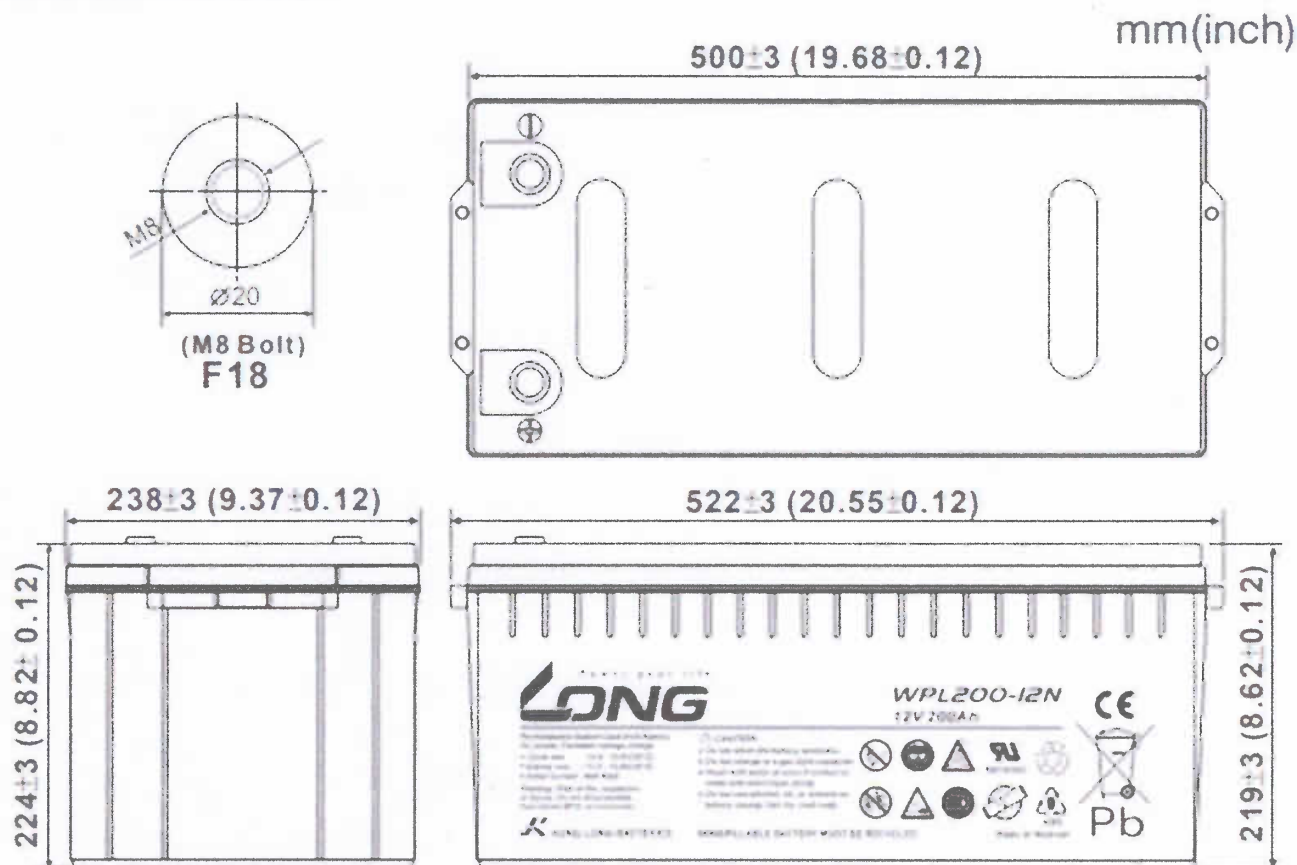



1. Test Item:

No	Test Item	Clauses.	Verdict
1	Gas Emission	6.1	P
2	High current tolerance (High current discharge capacity)	6.2	P
3	Short circuit current and DC internal resistance	6.3	P
4	Protection against internal ignition from external spark sources	6.4	P
5	Protection against ground short propensity	6.5	P
6	content and durability of required markings	6.6	P
7	Material Identification	6.7	P
8	Valve operation	6.8	P
9	Flammability rating of materials	6.9	P
10	Intercell connector performance	6.10	P
11	Discharge Capacity	6.11	P
12	Charge retention during storage	6.12	P
13	Float service with daily discharges 25°C, 80%	6.13	P
14	Recharge behavior	6.14	P
15	Service life at an operating temperature of 40°C all units to 0.8 C _n	6.15	P
16	Impact of a stress temperature of 60°C, 80%	6.16	P
17	Abusive over- discharge	6.17	P
18	Thermal run away sensitivity	6.18	P
19	Low temperature sensitivity	6.19	P
20	Dimensional stability at elevated internal pressure and temperatures	6.20	P
21	Stability against mechanical abuse of units during installation	6.21	P



2. Test Result:

No.	Test Item	Clauses	Technical Specification	Test data
1	Gas Emission (V=Voltage per cell)	6.1	$U_{f0} \leq 0.05 \text{ ml/cell} \cdot \text{h} \cdot \text{Ah} (25^\circ\text{C})$	0.0107
			$2.40 \text{ Vpc} \leq 1.70 \text{ ml/cell} \cdot \text{h} \cdot \text{Ah} (25^\circ\text{C})$	0.0195
2	High current tolerance (High current discharge capacity)	6.2	Discharge with 3 times of 15min rate current, or with a current equal to the maximum allowable discharge current. there is no melting or continuous power loss. $V_{5\text{min}} > 2.0 \text{ Vpc}$	Discharge with 3 times of 15min large current, there is no melting or continuous power loss. $V_{5\text{min}} = 12.96 \text{ Voltage}$
3	Short circuit current and DC internal resistance	6.3	I_{sc}	$I_{sc}: 3777 \text{ A}$
			Internal Resistance (IEC)	$R_i: 0.0033 \Omega$
			Internal Resistance (At 1KHz)	$2.8 \text{ m}\Omega$
4	Protection against internal ignition from external spark sources	6.4	There is no fast burn or explosive apart from valve	There is no fast burn or explosive apart from valve
5	Protection against ground short propensity	6.5	No earthing short or leakage	No earthing short or leakage
6	content and durability of required markings	6.6	Marks are easy for long-lasting	Marks are easy for long-lasting
7	Material Identification	6.7	ISO symbol is visible, and the symbol is remain after put in chemical reagent place	ISO symbol is visible, and the symbol is remain after put in chemical reagent place
8	Valve operation	6.8	Check the gas outlet before and after high-temp.	Open/close valve pressure (Kpa) is: Bef. high-temp.: 22.7/0.96 After high-temp.: 23.8/1.07
9	Flammability rating of materials	6.9	Indicate sample's value with same thickness of containers and lids	ABS UL94HB (UL94 V-0)
10	Intercell connector performance	6.10	Indicate highest temp. reached	31.6°C
11.	Discharge Capacity	6.11	$C_{10} \geq 200 \text{ Ah}$ $C_8 \geq 184 \text{ Ah}$ $C_3 \geq 150 \text{ Ah}$ $C_1 \geq 120 \text{ Ah}$ $C_{0.25} \geq 100 \text{ Ah}$	$104.7\% @ 20.0 \text{ A}$ $106.9\% @ 23.0 \text{ A}$ $109.6\% @ 50.0 \text{ A}$ $111.3\% @ 120 \text{ A}$ $112.5\% @ 400 \text{ A}$
12	Charge retention during storage	6.12	$\geq 70\%$	85.8%
13	Float service with daily discharges $25^\circ\text{C}, 80\%$	6.13	Total Cycle times ≥ 300	449 times
14	Recharge behavior	6.14	$R_{\text{ref}24\text{h}} \geq 90\%$	96.7%



			$R_{bf168h} \geq 98\%$	103.5%
15	Service life at an operating temperature of 40°C all units to 0.8 C_{rt}	6.15	- Brief duration exposure time $\geq 500d$ - Medium duration exposure time $\geq 750d$ - Long duration exposure time $\geq 1100d$ - Very long duration exposure time $\geq 1700d$	1718d (Very long duration exposure time)
16	Impact of a stress temperature of 60°C, 80%	6.16	- Brief duration exposure time $\geq 105d$ - Medium duration exposure time 175d - Long duration exposure time $\geq 250d$ - Very long duration exposure time $\geq 350d$	392d (Very long duration exposure time)
17	Abusive over- discharge	6.17	Unbalanced series over discharge $C_{aod} > 0.80$	0.87
			Cycle over discharge $C_{aoc} > 0.90$	0.98
18	Thermal run away sensitivity	6.18	Battery temperature change at 2.40VPC, the temperature after 168h	23.6°C
			Battery temperature change at 2.60VPC, the temperature after 168h	30.6°C
19	Low temperature sensitivity	6.19	$C_{als} > 95\%$	96.5%
20	Dimensional stability at elevated internal pressure and temperatures	6.20	percentage deviation over the girth value	$\Delta L = 0.04\%$
21	Stability against mechanical abuse of units during installation	6.21	No fracture or leak of the battery case	No fracture or leak of the battery case

— — — The End of Test Report — — —